


ILLUM. LED FLEX-NEON 'PIERCING BY NURSES' LETTERS ON SUSPENDED PANEL - SECTION DETAIL

D-1

SCALE: N.T.S.

INTERIOR INSTALL

A LED FLEX TUBE	
TYPE:	EVERYLITE 8mm FLEX NEON LED TUBELIGHT.
COLOR/ FINISH:	WHITE
B PANEL	
MATERIAL:	1/4" CLEAR ACRYLIC.
COLOR/ FINISH:	CLEAR
C STAND-OFF SYSTEM	
TYPE:	Ø1/8" STEEL AIRCRAFT CABLE GRIPPLE SYSTEM (10 FT.)
COLOR/ SYSTEM:	BRUSHED SILVER FINISH, VERIFY.
I WIRING	
I-F:	120V ELEC. OUTLET BOX BY OTHERS.
I-P:	12awg ELEC. OUTLET PLUG. WHITE COLOR.
I-S:	LOW VOLTAGE FEED WIRE. WRAP AROUND CABLE.
I-C:	SCREW POST PASS-THRU CONNECTOR.
WIRE NOTE:	WIRES TO BE TERMINATED w UL LISTED FASTENERS
J POWER SUPPLY	
TYPE:	REMOTE LED POWER SUPPLY & DISCONNECT SWITCH HOUSED IN WEATHER-PROOF TOP ACCESS ENCLOSURE
VOLTAGE:	120V
M MOUNTING	
M-1:	SEE INSTALL NOTE. REQ'D. BLOCKING BY OTHERS.
M-2:	MECH. FASTENERS THRU CEILING, VERIFY.
M-3:	MECH. FASTENERS @ BACK.
M-4:	COUNTER WEIGHTS TO BALANCE SIGN. V.I.F.
FINISH:	BRUSHED SILVER FINISH, VERIFY.

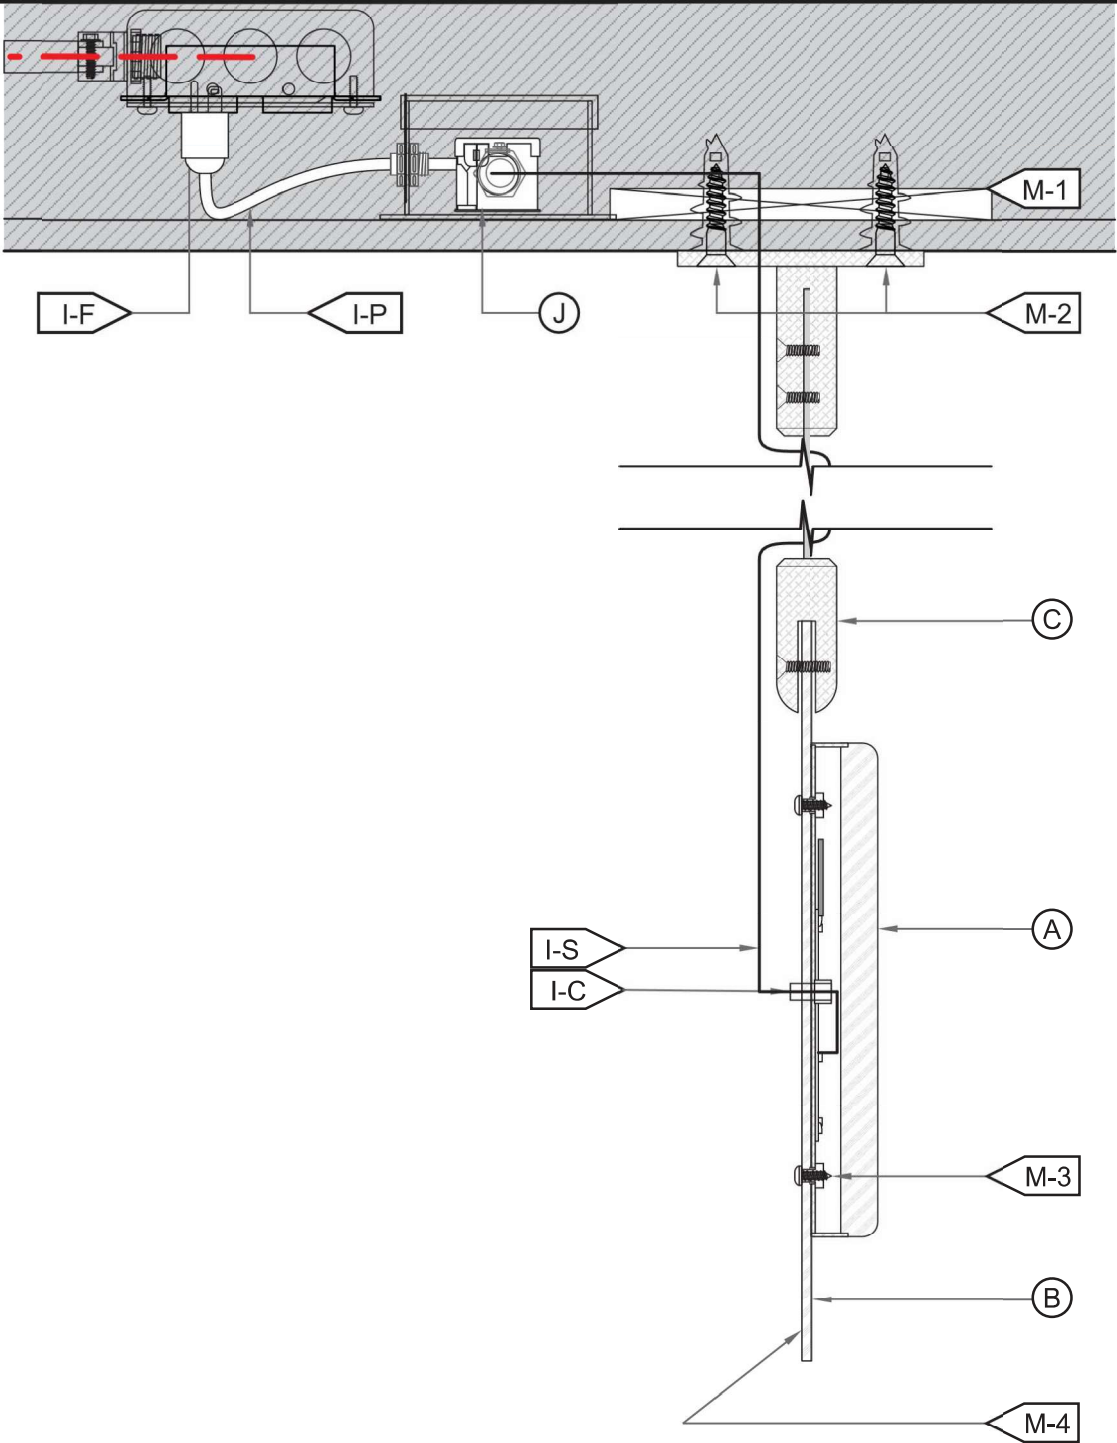

120V INSTALL	1. CUSTOMER G.C. TO PROVIDE ADEQUATE WOOD OR MTL. BLOCKING IN CORRELATION W/ FACADE FRAMING AS REQUIRED. 2. INSTALLER IS TO V.I.F. & PROVIDE THE PROPER NON-CORROSIVE MOUNTING HARDWARE TO ENSURE SAFE INSTALLATION. 3. ALL EXTERIOR FACADE PENETRATIONS TO BE WATERTIGHT. 4. INSTALLATION TO MEET CURRENT N.E.C., U.L. & LOCAL CODES. LOCATION OF THE DISCONNECT SWITCH AFTER INSTALLATION SHALL COMPLY WITH ARTICLE 600.6(A) (1) OF THE NATION ELECTRICAL CODE	ELECTRICAL	1. ALL ELECTRICAL COMPONENTS TO BE U.L. APPROVED. 2. CUSTOMER IS RESPONSIBLE FOR ONE (1) 120v/ 20a DEDICATED CIRCUIT w/ GROUND PER SIGN TO WITHIN 6' OF SIGN. 3. THIS SIGN IS INTENDED TO BE INSTALLED IN ACCORDING W/ THE REQUIREMENTS OF ARTICLE 600 OF THE NATIONAL ELECTRICAL CODE AND/OR OTHER APPLICABLE LOCAL CODES. THIS INCLUDES PROPER GROUNDING & BONDING OF THE SIGN.	FABRICATOR	1. PLACEMENT OF LIGHTING ELEMENTS FOR OPTIMUM ILLUMINATION OF SIGN TO BE DETERMINED IN PRODUCTION. 2. MANUFACTURER & U.L. LABELS TO BE APPLIED & VISIBLE FROM THE GROUND. LOCATED ON THE LAST CHANNEL LETTER OR END OF THE SIGN BOX/FREESTANDING SIGN	 ALL ELECTRICAL COMPONENTS ARE TO BE UL APPROVED

